

MULTI-POINT CAPACITANCE TYPE LEVEL SWITCH


Model **KCD**



NO MOVING PART!! FIVE-POINT OUTPUT!!

KCD Multi-point Capacitance Type Level Switch

WE HAVE INVENTED THE 5-POINT OUTPUT WITH AN ELECTRODE!

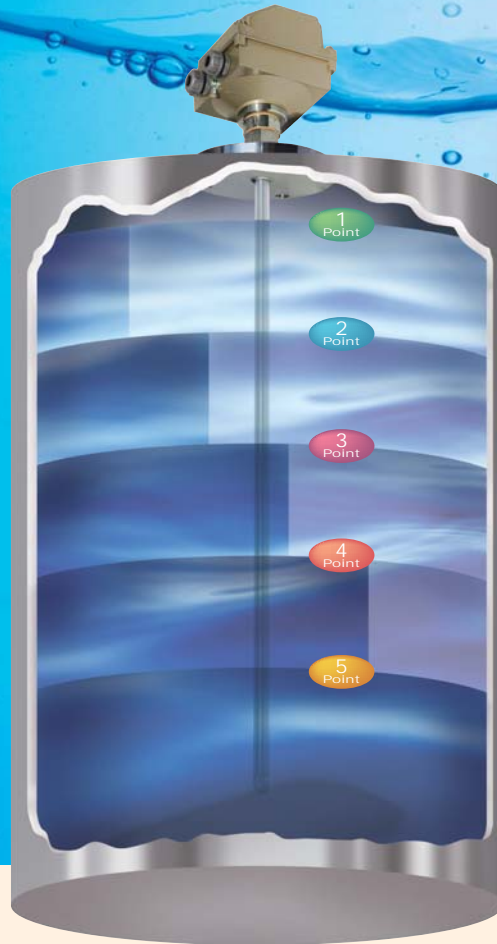

THE DETECTION POSITION CAN ARBITRARILY BE CHANGED!


CAPACITANCE TYPE SERIES FOR CONTACT LEVEL MEASUREMENT.

**Reliably detecting level for liquids
(Conductive Liquids / $\Delta C = 300 - 800\text{pF}$)**

FEATURES


- You can easily set 5 points via digital display by way of zero span adjustment only.
- As opposed to a level switch whose contact position is fixed, you can arbitrarily change the alarm position if it is within the measuring range of the electrode.
- Alarm operative direction (ON when a liquid level rises, or ON when the level comes down) can be changed by selecting the proper terminal on the amplifier PCB.
- Even when the tank material is other than metal, it can fully operate with an auxiliary electrode installed or with an earth of a metal tape provided outside of the tank.

WIRING DIAGRAM / AMPLIFIER

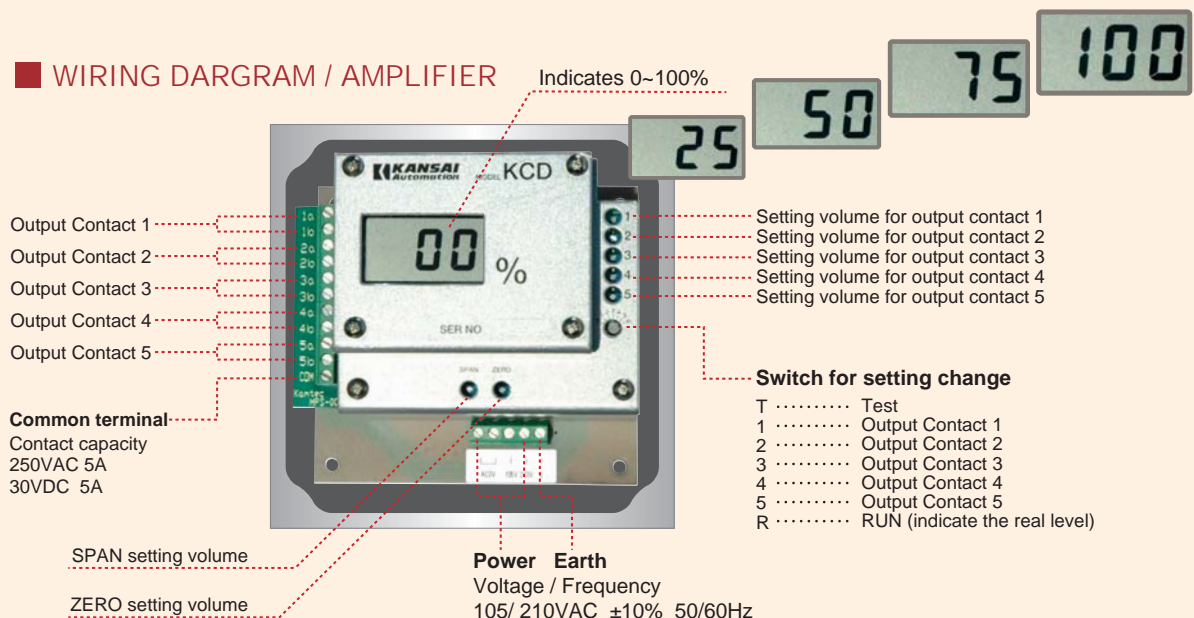

PRINCIPLE OF OPERATION

As it is mounted coaxially with the tank wall (see the diagram on the right), capacitance $C \times (= C_0 + \Delta C)$ will be formed between the tank wall and the electrode. Converting C_0 to synchronized square-wave pulse, it retrieves pulse-width modulated in proportion to ΔC in the form of voltage level. It compares the voltage level with values set by the Set Volume and provides output contact signals.



$$V \propto \Delta C$$

$$V \propto \text{SPAN}$$

$$I_0 \propto V$$

$$I_0 \propto \text{SPAN}$$

ϵ_x : Relative permittivity of an object to be measured

ϵ_0 : Relative permittivity of air ≈ 1

V : Signal Voltage


I_0 : Out put Current (Option)

$$\Delta C = \frac{K \times (\epsilon_x - \epsilon_0) \times \text{SPAN}}{\text{Log}_{10} (R/r)}$$


$$\Delta C = C_x - C_0 \text{ (Capacitance when tank is empty, } K = \text{constant)}$$

OUTLINE DRAWING


KCD-110C TEFLON COATING ELECTRODE (max.60°C)

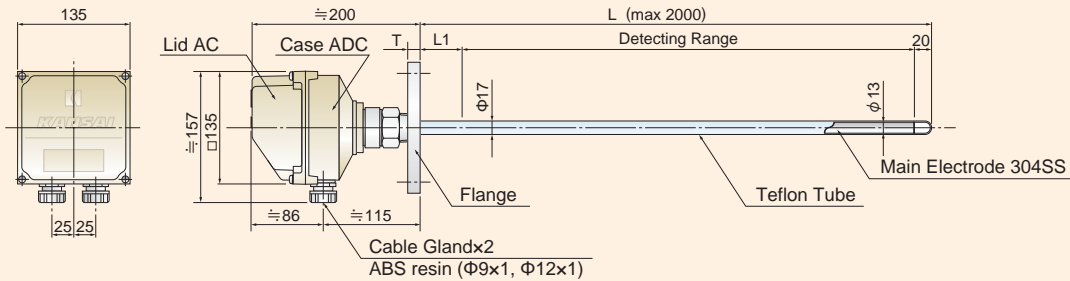

KCD-110C-H HEAT-RESISTANT TEFLON COATING ELECTRODE (max.120°C)

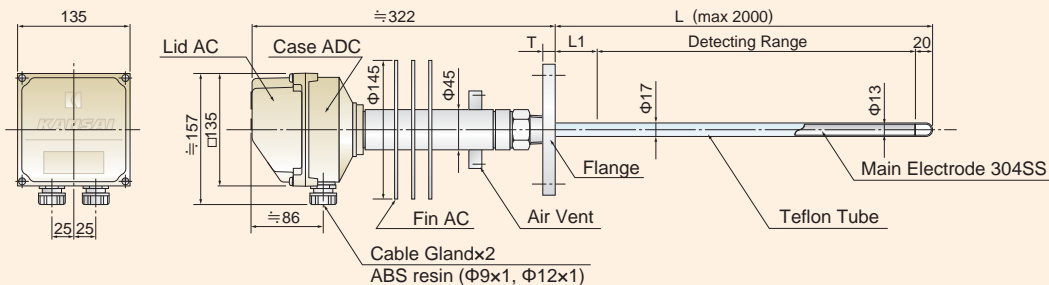


KCD-310C WIRE-TYPE TEFLON COATING ELECTRODE (max.60°C/ max.120°C for heat-resistant Type)

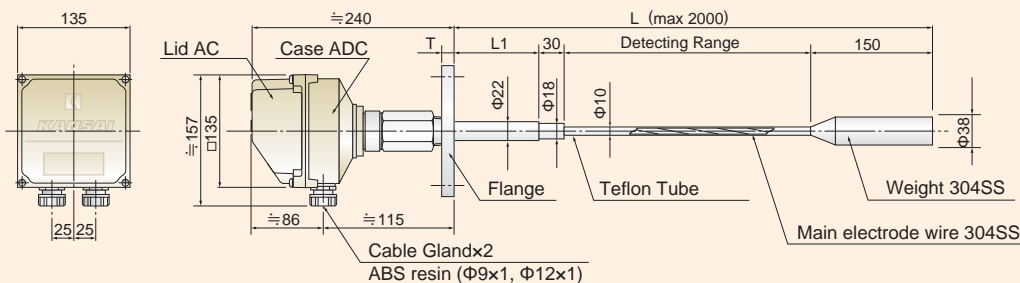

SPECIFICATION


Supply Voltage	105 /210VAC $\pm 10\%$ 50/60Hz
Power Consumption	4.5VA
Temperature	0~55°C (No condensation)
Output Contact	5C COMMON
Contact Capacity	250VAC 5A / 30VDC 5A
Setting & Display	0~100% Digital display
Relative Permittivity suitable for measurement	Conductive liquids (depend on the object to be measured)
Accuracy	2% (Amplifier only)
Probe Length	Maximum 2m (Straight rod and wire / coated electrode) *Please consult with us when the probe exceeds 2m.

DESIGNATION OF MODEL

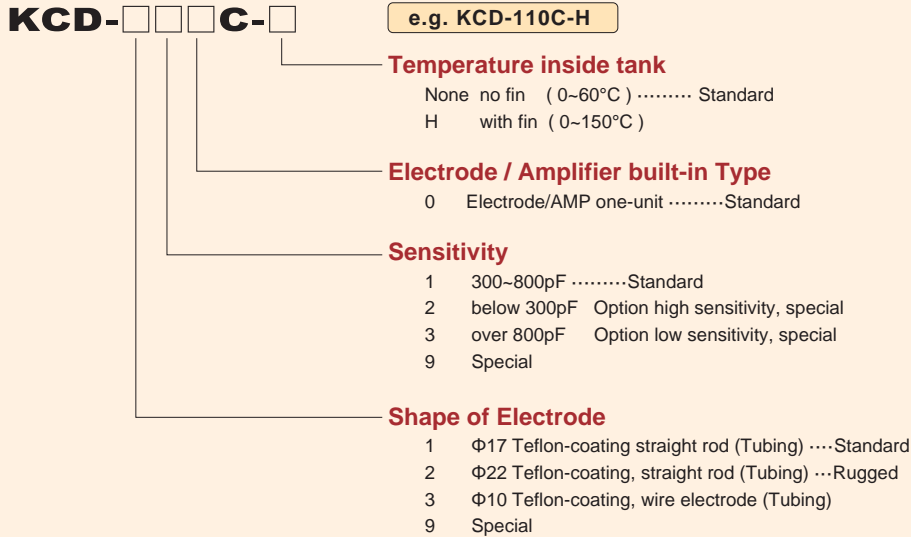

Just a KCD model can control water supply / drainage and provide respective alarm

It is so simple to change a detection position with a flathead screwdriver while watching the display screen without changing the liquid level. Flexibly responds to process changes.

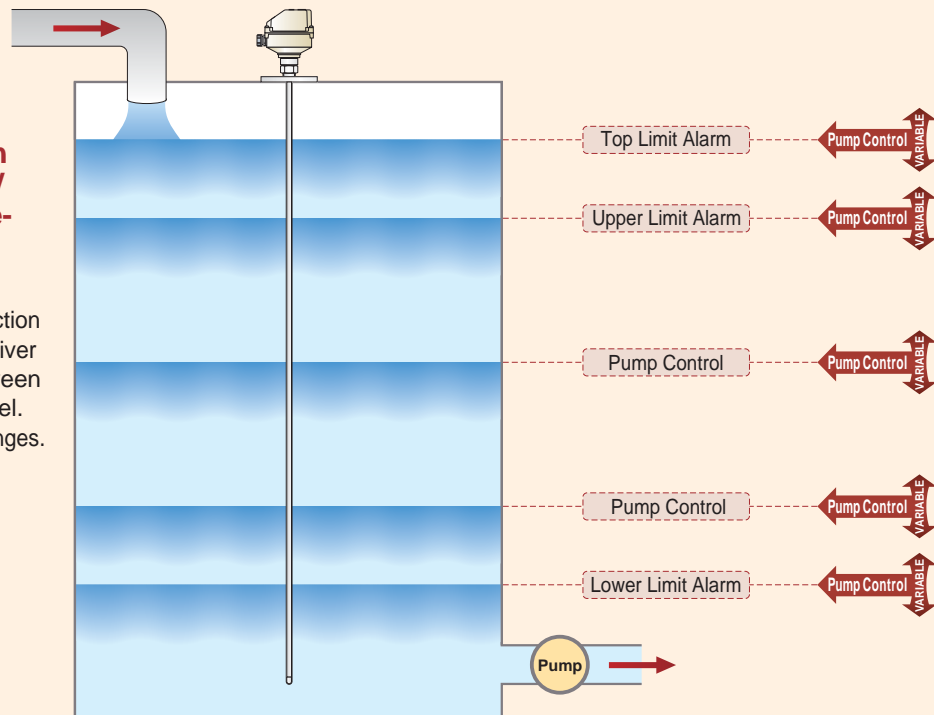

Line of business

- Rotary Paddle Type Level Switch
- Vibration Type Level Switch
- Swing Type Level Switch
- Acoustic Level Switch
- Capacitance Type Level Switch
- Capacitive Proximity Sensor
- Capacitance Type Level Indicator
- Diaphragm Type Level Switch
- Tilt Switch
- Leak Type Level Switch
- Microwave Switch
- Sounding Bob Type Level Indicator
- Flow Switch
- Conductance Type Level Switch
- Float Switch
- Float Type Level Indicator
- Ultrasonic Type Level Indicator
- Equipments For Conveyor Lines
- Dust Monitor System
- Zirconia Oxygen Analyzer
- Laser Type Level Indicator
- RADAR Type Level Indicator
- On-line Sensors for Accurate Liquid Analysis
- Ultrasonic Flow meter

All-round Manufacturer of Level Controllers for Powder, Granules and Liquid

KANSAI Automation Co., Ltd.

Headquarters:
2-14, Togano-cho, Kita-ku, Osaka 530-0056, Japan
TEL. 81-6-6312-2071 FAX. 81-6-6314-0848
e-mail: info@kansai-automation.co.jp

<http://www.kansai-automation.co.jp>

Tokyo Branch: 1-29-6, Hamamatsu-cho, Minato-ku, Tokyo 105-0013, Japan
TEL. 81-3-5777-6931 FAX. 81-3-5777-6933

Nagoya Office: 3-31-27, Uchiyama, Chigusa-ku, Nagoya 464-0075, Japan
TEL. 81-52-741-2432 FAX. 81-52-741-1588

Kyushu Office: 1-2-39, Asano, Kokura Kita-ku, Kitakyushu 802-0001, Japan
TEL. 81-93-511-4741 FAX. 81-93-511-4580



*Please be sure to read USER'S GUIDE, Installation & Operation Instructions before using the instrument.

*The specifications herein may be subject to change without advance notice.

Agent